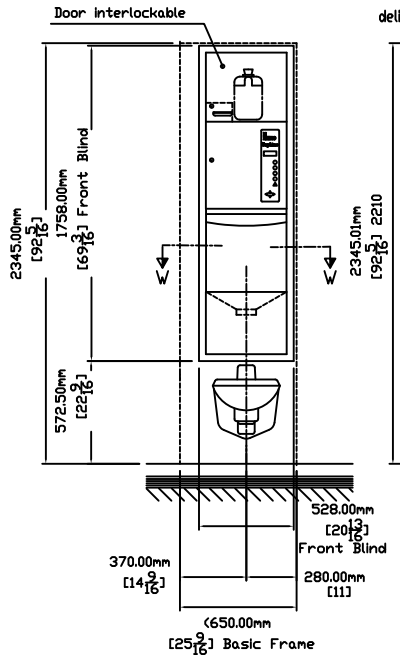

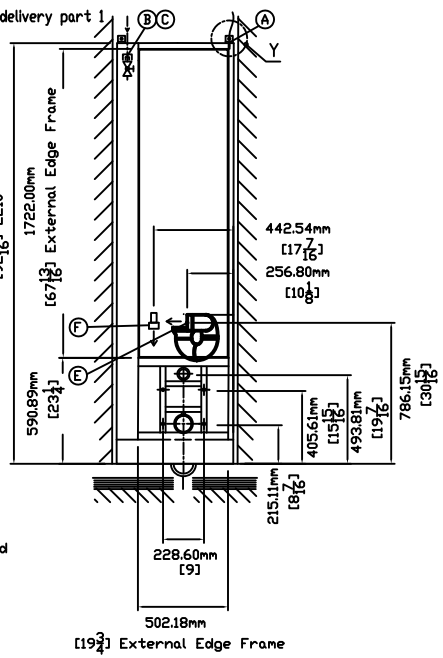

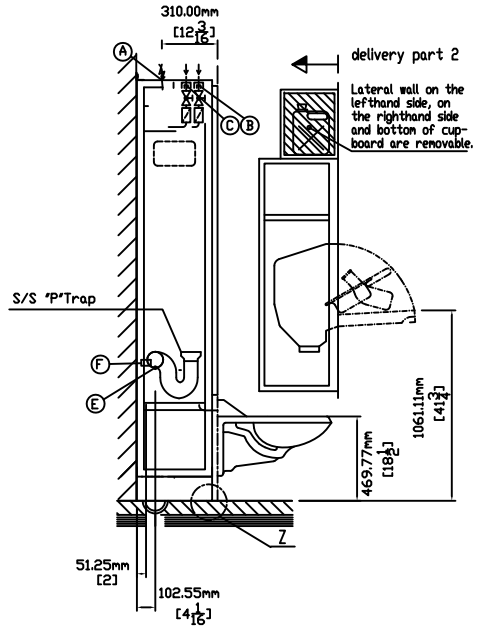

FOR U.S. INSTALLATION ONLY.



Note: See DPA-2522-10

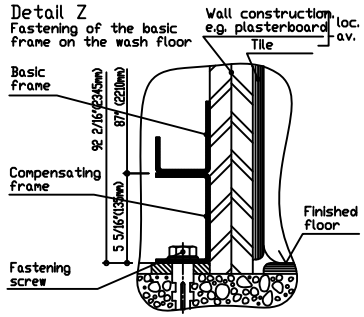

Note: See DPA-2522-10

Weight of frame 30 kg. - 66 lbs.
Weight of unit 80 kg. - 176 lbs.
Total weight 110 kg. - 242 lbs.

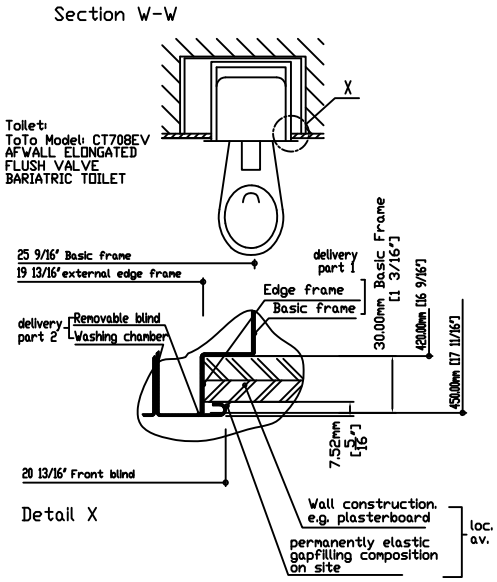



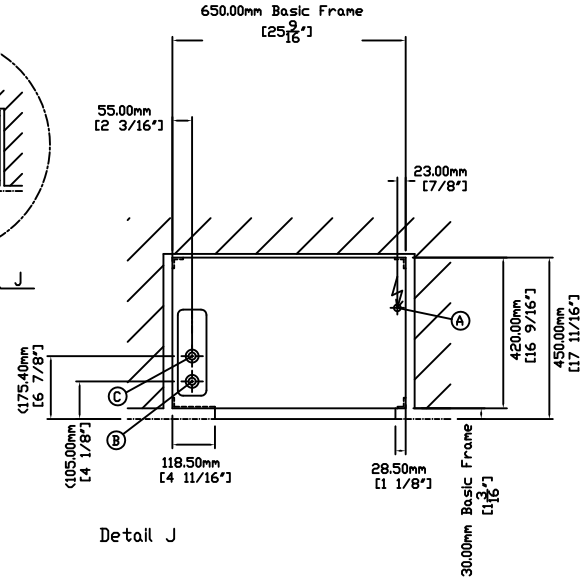

Sanitary installation		MEIKO	In the building
B	Cold Water	R 1/2" NPT, Stop-cocks, "Y" Strainer	Inlet pipe 3/4", 41°-77°F Flow: flow pressure >4.76 Gal/Minute., >14.5 PSI
C	Hot water	R 1/2" NPT, Stop-cocks, "Y" Strainer	Inlet pipe 3/4". Stop-cocks, 110°-140°F Flow: flow pressure >4.76 Gal/Minute., >14.5 PSI
E	Waste Outlet	3" "P" Trap	Waste Pipe 3" DFU 4
F	Vent	2" Vent Connection	Local Area Vent 2" 12.4 CFM
Electrical installation			Cable from top edge basic frame about 5'. Main fuse. Protection: 3x15A. Protective measures as well as connection of the equi-potential bonding must be carried out according to IEC 364-5-54 and conform to the local and national power utilities regulations.
A	3 PH ~ 208/230V, 60Hz, 4.2KW/4.6KW		
Protection class: Equipment Class 1, Pollution Degree 2, Installation Category II, Main switch,			

Connection dimensions are subject to tolerances.
It is neither allowed to give this drawing without our permissions to a third party for information or reproduction, nor may it be used for competition purposes. All rights are reserved ! Subject to technical changes.

MEIKO USA INC.
1349 Hell Quaker Blvd. LaVergne TN 37086
UNITED STATES OF AMERICA
TEL. (615)399-6600; FAX: (615)399-6600

Alter.	Drawn:	Checked:

Reference

Type TOPLINE30WC DT-NDV LH ADA
Thermal disinfection,Internal Steam Generation

Proj. no.

Drawing no. | Index

Scale: 1:20 | Drawn: rm | Date: May.10.2011 | Checked: dlb | Date: May.10.2011