



	(RIGHT by MEIKO			
1.0	machine connection: drain connection hose, DN 22 hose fitted as odour trap in interior of machine			
1.1	drain (max. 700 mm above finished floor level), DN 50			
2.0	Machine connection: fresh water supply, G 3/4"			
2.2	Soft cold water 10°C, DN 15, G 3/4 a max. 0,54 mmol/I CaCO₃ (max. 3°dH) Flow rate: 5.0 l/min Minimum flow pressure: 60 kPa / 0.6 bar in front of solenoid valve Maximum pressure: 500 kPa / 5.0 bar stopcock and fine screen ≤ 25 µm			
3.0	Machine connection: electrical connection cable 10G 4mm ²			
3.1	electricity supply to the machine: 3 PE 200V ~ 50Hz nominal current / - capacity: 38.4 A / 11.6 kW Voltage equalising cable The master switch must be provided on site			
6.0	 eat load of warewash area he values apply for the following room conditions: oom temperature 22 °C, rel. humidity 55 % Recommended suction area according to German EN 16282 of any local regulations have to be observed to determine ventilation of wash areas he total heat load includes 6.1 			
6.1	Heat load of the machine in normal washing operation: for 15 programme cycles/h total 4.5 kW, perceptible 3.0 kW, latent 1.5 kW For the total space load, all other space loads must be considered. The space ventilation must be designed in accordance with EN 16282.			
all cat	bles, pipes etc leaving machine 1,4 m			
	hine Equipment			
	ank / boiler locked			
	intry height			
	floating terminals (200V) for local dosing system			
	Back wall cladding			
Dack				

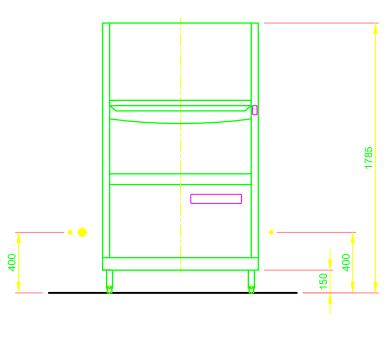

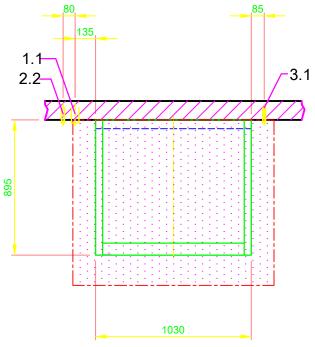

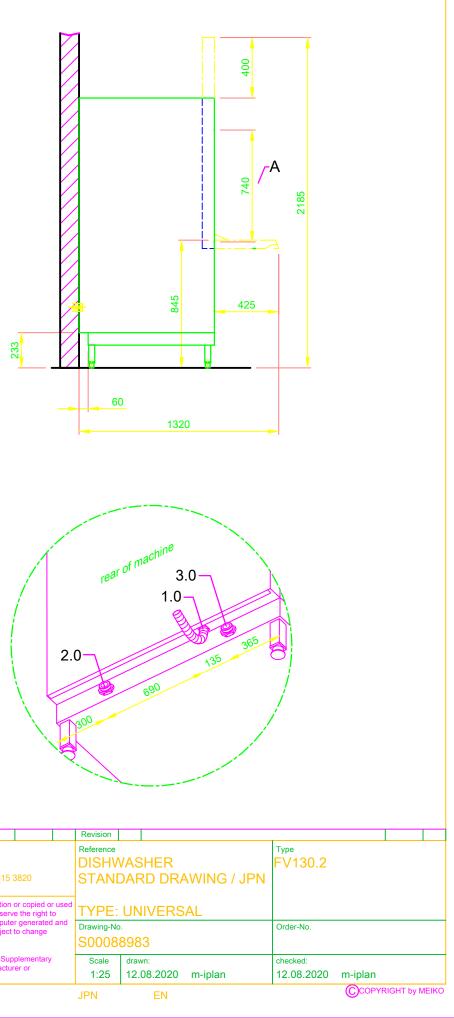

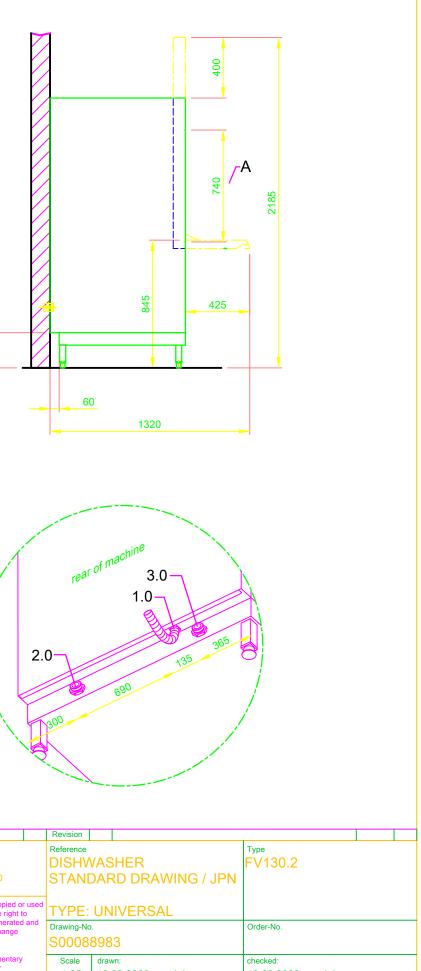

		Revision	
MEIKO Clean Solutions Japan k.k. 2F 1-22-13 Asahigaoka Nerima Tokyo Japan 176-0005 TEL. +81 3 6914 4301 TELEFAX +81 3615 3820 E-MAIL: info@meiko-japan.com			
This drawing may not be neither passed to third parties for their information or copied or used for competitive purposes without our consent. All rights reserved. We reserve the right to make changes resulting from technical progress. This drawing was computer generated and s not subject to the checking and any release process; it is also not subject to change management. Please note:			
This document is only valid in conjunction with the conditions defined in Supplementary Sheet "Important Information". These can be requested from the manufacturer or lownloaded from the Partnernet.			
		JPN	



EN